

ABB MEASUREMENT & ANALYTICS | DATA SHEET

# C1960

## Multi-recipe profile recorder/controller





---

## **Measurement made easy**

C1960 – for universal ramp/soak applications

### **Ideal for autoclave/retort control**

- suitable for cooking many products

### **Designed for the control of tire presses and dyebeck process**

- adjustment of the soak time is a fingertip operation

### **Easy selection of multi-segment profiles**

- 99 segments and 10 profiles to suit the most complex process

### **Dedicated operator display of segment status**

- clearly shows current segment running, cook temperature and time

### **Automatic operation with manual override**

- dedicated switches, warning lights and status LEDs
- intelligent power failure recovery

### **Guaranteed ramp/soak with individual hysteresis**

- two hysteresis (deadband) settings per program

### **Faster start up with self-seeking set point**

- to save you process time

### **Easy-clean NEMA 4X/IP66 enclosure**

- hosedown and harsh applications



## Introduction

The C1960 multi-recipe profile recorder/controller has advanced ramp/soak profiling designed specifically for the food processing, canning, tire and dyebeck industries.

The range of products available gives you the ability to use the C1960 not only for control but to also record other process variables.

Specialized features include guaranteed ramp/soak, a dedicated operator display and time events to assign relays/outputs to individual or multiple segments.

The C1960 is a totally self-contained unit suitable for panel-, wall- or pipe-mounting with NEMA4X/IP66 enclosure protection as standard.

The C1960 is available in four versions:


- C1961
  - One controller and one recording pen with control and ramp/soak faceplates
- C1962
  - One controller and two recording pens with control, record and ramp/soak faceplates
- C1963
  - One controller and three recording pens with control, record and ramp/soak faceplates
- C1964
  - Two controllers and two recording pens with two control and one ramp/soak faceplates for Channel 1

Other circular chart recorders also available from ABB include:

- C1900
  - Recorder/Controllers
- C1950
  - Pasteurizer recorder/controller

### Application areas include:

- Autoclaves
- Retort control
- Pneumatic upgrades
- Tire presses
- Dyebeck
- Smokehouses
- Kilns

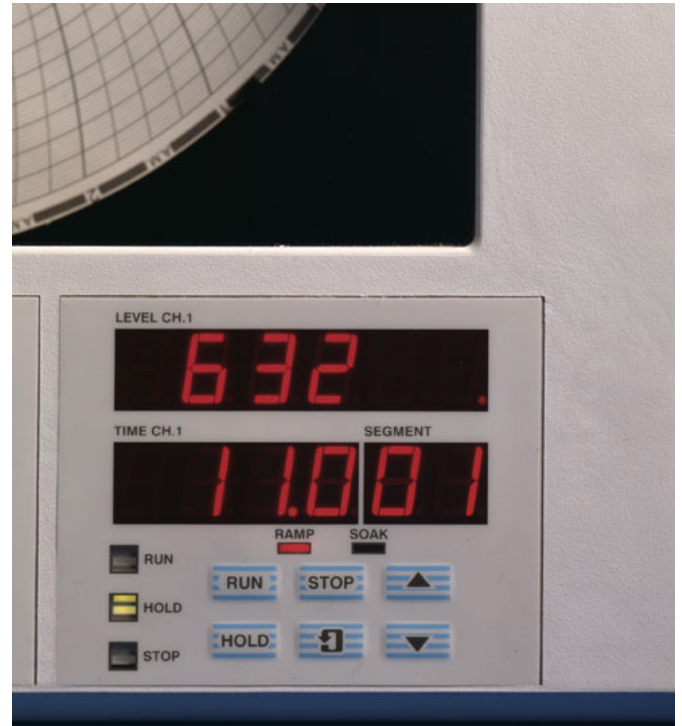

## Ramp/soak profiles – easy to compile


Profiles are programmed via the front panel. Time scales can be set in hours or minutes and ramp segments can be configured using segment time (hrs/min) or ramp rate (°C or °F, min or hrs)

The C1960 can store up to 20 programs, 10 per control channel, as standard

## Guaranteed ramp/soak

This feature has been designed to make operation as flexible as possible. There are two hysteresis settings; one applicable to soak segments, the other to ramp segments.


The guaranteed hysteresis value can be applied to individual segments above set point, below set point, both or none. This gives the user the option to HOLD a cycle only if it falls outside a preset value, i.e. where regulations state a minimum (but no maximum) temperature or where the ramping segment is allowed to reach temperature as quickly as possible, so saving process time and money.

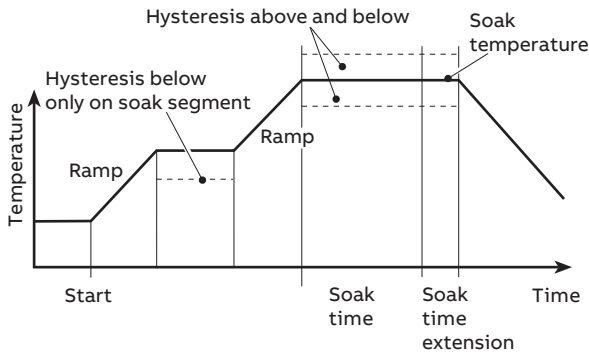

Guaranteed ramp/soak

## Product/profile selection

Recipes can be selected either via the front panel, multi-position selector switches connected to the C1960's digital inputs or by a MODBUS Master, allowing the selection of a profile for the product being processed in the most convenient format.

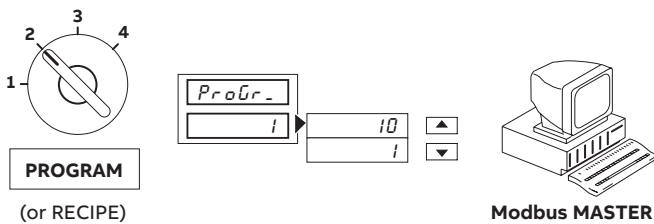


## Dedicated ramp/soak display

Status LEDs give a clear indication of the current state of the profile, showing whether a ramp or soak is being performed. A dedicated display indicates the segment which is currently running, together with the standard controller display which shows the current set point and actual process value.

The highest cook temperature and time is also indicated on the dedicated display on the retort control version. The segment temperature and time is displayed on the advanced control version. Dependent upon the process, these values can be increased or decreased via the front switches or digital inputs.

The profile can be started, stopped or put on hold via the dedicated switches on the front face or by external digital input.

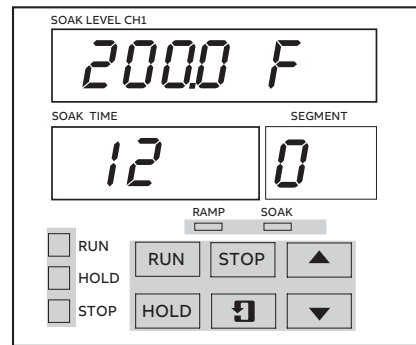

## Programmable power failure recovery


The power failure recovery function allows pre-selection of the restart position within the profile. If the power is restored within the programmable power down time, the C1960 resumes from the point in the profile that the power failed. If, however, the power down time has expired, the C1960 holds the program and can restart in three different ways:

- 1 the current program from the beginning;
- 2 the current segment;
- 3 or the segment from the position at the time of failure.



## Event states

The C1960 has 6 common events that can be allocated to relay or digital outputs and each segment can be configured to enable any event. This enables an event to be triggered from multiple segments, or for one segment to trigger multiple events, providing a flexible and powerful control strategy.

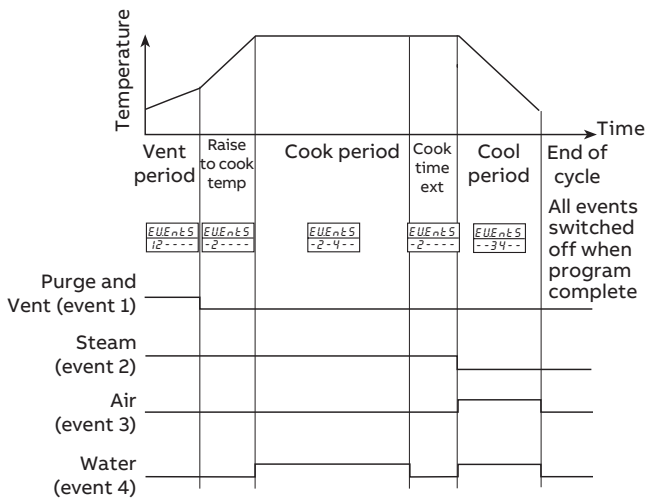

Event states


## Self-seeking set point

To reduce process time the C1960 has a self-seeking set point setting which enables a profile to start from the current process temperature. This eliminates the wasted time normally taken to drive the process temperature down to the actual start temperature for the profile.

## Sequencing and logic control

The C1960 offers comprehensive sequencing to complement its advanced analog control features with eight logic equations and up to seven elements per equation. These eight logic equations, when combined with real-time alarms, program and segment events make the C1960 a powerful sequence recorder/controller.

For safety purposes, logic equations can be included as part of the profile control, disabling the ability to run unless all safety interlocks are in place.

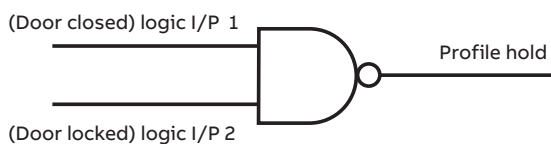

## Process alarms

The C1960 has four internal process alarm inputs per channel. These can be soft-wired to control strategies, logic equations and output relays.

Each alarm can have a separate hysteresis value, programmable in engineering units and/or time. Alarms can also be enabled or disabled via digital inputs.

## Ideal replacement for pneumatic products

Profile cycle can be controlled automatically or, at the touch of a button, switched to manual control. Dedicated switches to increase or decrease cook/soak times give manual control of the process when required.


All front panel switches can be replicated on an external panel using digital signals.

## Retort function

The Retort function ensures safe operation of retort vessels under fault conditions. If the heat source fails during a soak segment, the process variable inevitably falls. When the process variable falls below the holdback hysteresis value the program is put on HOLD (as for normal operation). The set point then follows the process variable as it continues to fall (retort hold). The set point then follows the process variable as it continues to fall (retort hold).

$$\text{Set point} = \text{Process Variable} + \text{Hysteresis Value}$$

Upon recovery of the heat source, the process is controlled at the new set point value. When the process variable reaches the set point it is then ramped back to the initial soak value at the rate of the previous ramp (retort ramp). When the soak level is reached the program is released from its hold state and the segment is either completed or repeated from the beginning, depending on the retort mode selected.

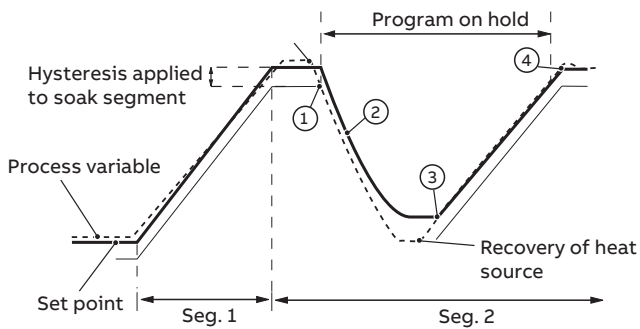

- ① The program is put on HOLD when the process variable falls below the holdback hysteresis
- ② The set point follows the process variable as it continues to fall. (SP = PV + hysteresis)  
The set point tracks the lowest value of the process variable
- ③ When the process variable reaches the set point, the set point is ramped back to the soak level at the rate of the previous ramp
- ④ Upon reaching the soak level, 'HOLD' is released and the segment is completed or repeated

Retort function




## Retort control 'K' software

### Operation

The retort control software has been designed for control of basic cooking functions. The dedicated display on the custom face indicates the 'Cook' time and temperature. This is assumed to be the highest 'Soak' level in the profile. These are normally simple profiles, having only a 'Ramp' and 'Soak' segment, then 'Off'.

The retort control software, through dedicated front panel keys, enables continuous adjustment of the 'Cook' temperature and time at any point during the profile, to suit the product being processed.

## Advanced control 'L' software

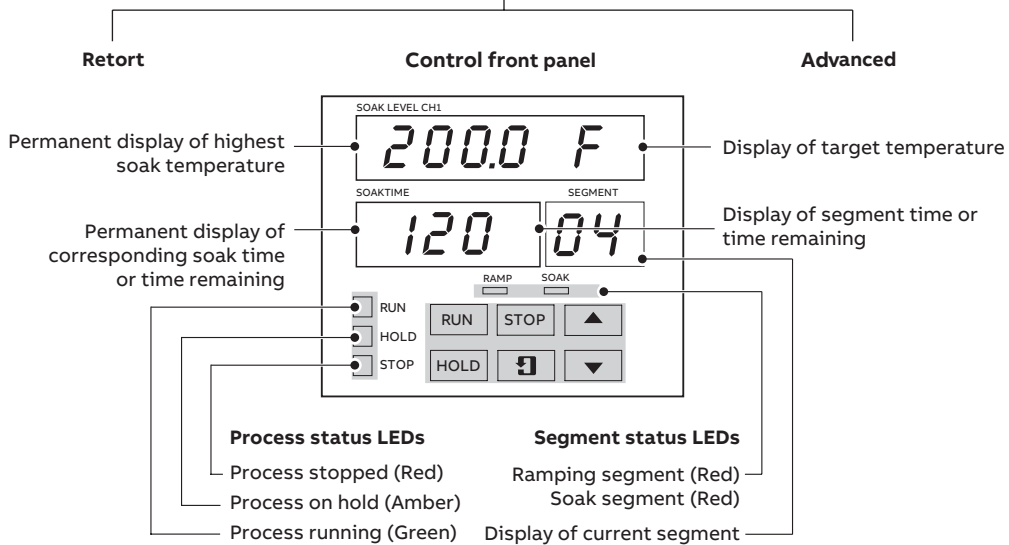

- Dedicated key to start profile  Dedicated key to start profile
- Dedicated key to set operator hold  Dedicated key to set operator hold
- Dedicated key to stop / reset profile  Dedicated key to stop / reset profile
- Scroll key selects between adjustment of soak time and soak level  Inactive with this software
- Increment soak time / soak level  Increment soak time
- Decrement soak time / soak level  Decrement soak time

## Ordering information

### Part 1 – general details

C1960 multi-recipe profile recorder/controller	19XX	X	X	X	X	X	X	X	X	X	X	X	X	XXX	OPT
<b>Pens/Controllers *</b>															
One control unit, one pen (red)	61														
One control unit, two pens (red, green)	62														
One control unit, three pens (red, green, blue)	63														
Two control units, two pens (red, green)	64														
<b>Chart type</b>															
Taylor ER/C charts		R													
KPC 105 PX and PXR type charts		S													
Chesell Brand charts		D													
<b>Electrical code</b>															
Standard			A												
CSA approved			B												
<b>Option module</b>															
None				O											
Additional I/O modules				A											
<b>Options</b>															
Retort control					K										
Advanced control					L										
<b>Door lock</b>															
No lock										1					
Lock fitted										2					
<b>Power supply</b>															
115 V AC															1
230 V AC															2
115 V AC with on/off switch															4
230 V AC with on/off switch															5
<b>Part 2 **</b>															
<b>Additional I/O modules</b>															
Module position 2/channel 2 input* (selection for C1961 only)					0	1	2								
Module position 3/channel 3 input* (selection for C1961, C1962 and C1964)					0	1	2								
Module position 4/channel 4 input*					0	1	2	3	4	5	6				
Module position 5					0	3	4	5							
Module position 6					0	4	5	8							
<b>Programming/special features **</b>															
Configured to factory standard															STD
Configured to customer requirements (customer to complete and supply C1960 custom configuration sheet – INF08/031)															CUS
Special features															SXX
Engineered configuration (customer to supply configuration details required)															ENG
Calibration certificate ***															C1
<b>Printed instruction manual</b>															
English															M5

\* Each pen fitted has an associated standard input/output module comprising analog input, analog output, relay, transmitter power supply and two digital inputs.

\*\* Additional input/output modules may be fitted in the unused module positions as required. These additional modules should be specified in Part 2 of the ordering information.

\*\*\* When a calibration certificate is ordered it is performed according to the specified configuration type:  
 CUS/ENG – Inputs and outputs calibrated according to the customer supplied configuration details and ranges.  
 STD – Inputs and outputs calibrated according to the instrument factory standard configuration and ranges.



---

### Key to module types

- \* 0 No module fitted/pen input channel
- 1 Standard input/output
- 2 Analog input + relay
- 3 Four relays
- 4 Eight digital inputs
- 5 Eight digital outputs
- 6 True time event pen – violet (event pen is additional to standard pens)
- 8 Modbus RS485 communications

For full technical specifications refer to data sheets

[DS/C1900R-EN](#) and [DS/C1900RC-EN](#).

---

## Acknowledgements and trademarks

Modbus™ is a trademark of Modicon, Inc.

---

## Notes

Sales



Service



Software







---

**ABB Limited****Measurement & Analytics**

Howard Road, St. Neots  
Cambridgeshire, PE19 8EU  
UK

Tel: +44 (0)1480 475 321

Fax: +44 (0)1480 217 948

Mail: [instrumentation@gb.abb.com](mailto:instrumentation@gb.abb.com)

**ABB Inc.****Measurement & Analytics**

125 E. County Line Road  
Warminster, PA 18974  
USA

Tel: +1 215 674 6000

Fax: +1 215 674 7183

**[abb.com/recorders](http://abb.com/recorders)**

---

We reserve the right to make technical changes or modify the contents of this document without prior notice. With regard to purchase orders, the agreed particulars shall prevail. ABB does not accept any responsibility whatsoever for potential errors or possible lack of information in this document.

We reserve all rights in this document and in the subject matter and illustrations contained therein. Any reproduction, disclosure to third parties or utilization of its contents – in whole or in parts – is forbidden without prior written consent of ABB.